




DROP CONNECTION FOR MANHOLES - INSIDE

Created: January 25, 2013

Revised: October 23, 2015

Scale: N.T.S.

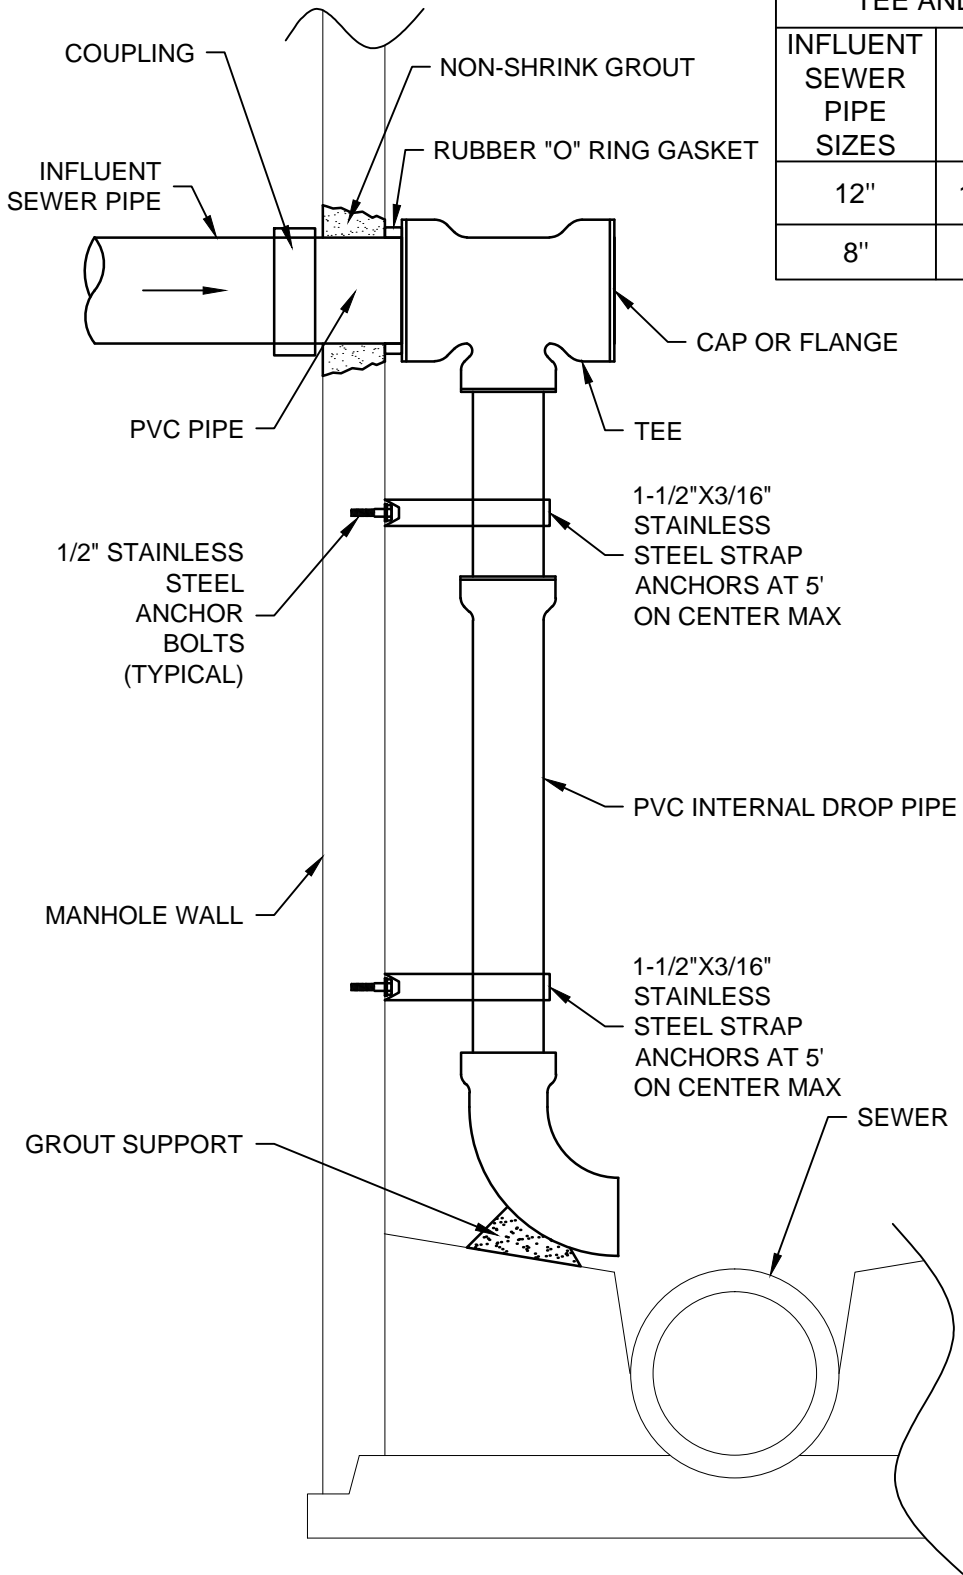

TEE AND DROP PIPE SIZES		
INFLUENT SEWER PIPE SIZES	TEE SIZES	DROP PIPE SIZES
12"	12"X12"X12"	12"
8"	8"X8"X6"	6"

NOTES:

1. THIS DETAIL IS NOT TO BE USED ON NEW CONSTRUCTION.