




# 48" STORM MANHOLE

Created: April 19, 2013

Revised: October 13, 2015

Scale: N.T.S.

Approved: May 16, 2012

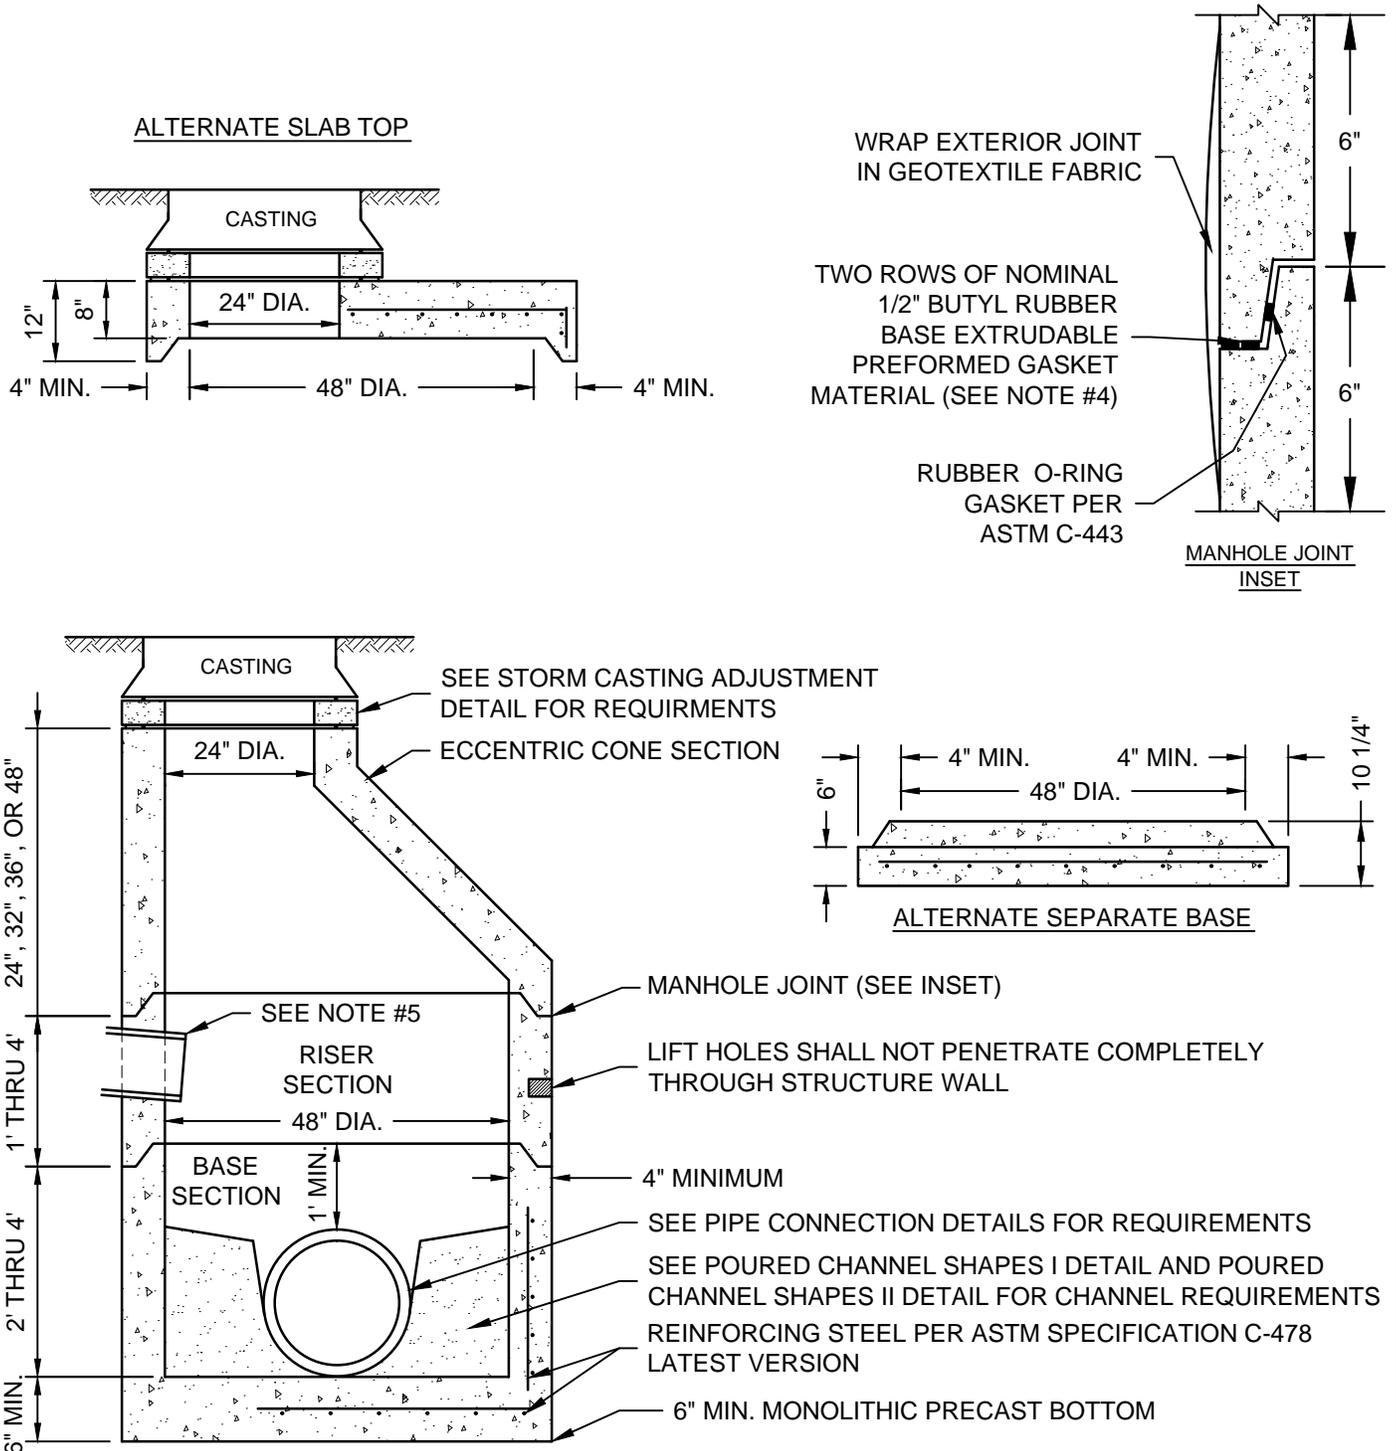

**NOTES:**

1. FOR ALTERNATE CAST-IN-PLACE BASE, SEE CAST-IN-PLACE BASE 48" AND LESS DETAIL.
2. THE BASE SHALL BE PLACED ON COMPACTED CRUSHED STONE, 4" MINIMUM.
3. THE INSIDE WALL DISTANCE BETWEEN OPENINGS SHALL BE A MINIMUM OF 6".
4. USE RU 106 RUB'RNK LTM AS MANUFACTURED BY HENRY CO., KENT-SEAL NO. 2 AS MANUFACTURED BY HAMILTON-KENT OR EZ-STICK BUTYL-RUBBER-BASED PREFORMED FLEXIBLE SEALANT AS MANUFACTURED BY PRESS-SEAL.
5. UNDERDRAIN CONNECTION SHALL BE ABOVE BENCH. SEE PIPE CONNECTION DETAILS FOR REQUIREMENTS.