




60" STORM MANHOLE

Created: January 1, 2002

Revised: September 4, 2015

Scale: N.T.S.

Approved: May 16, 2012

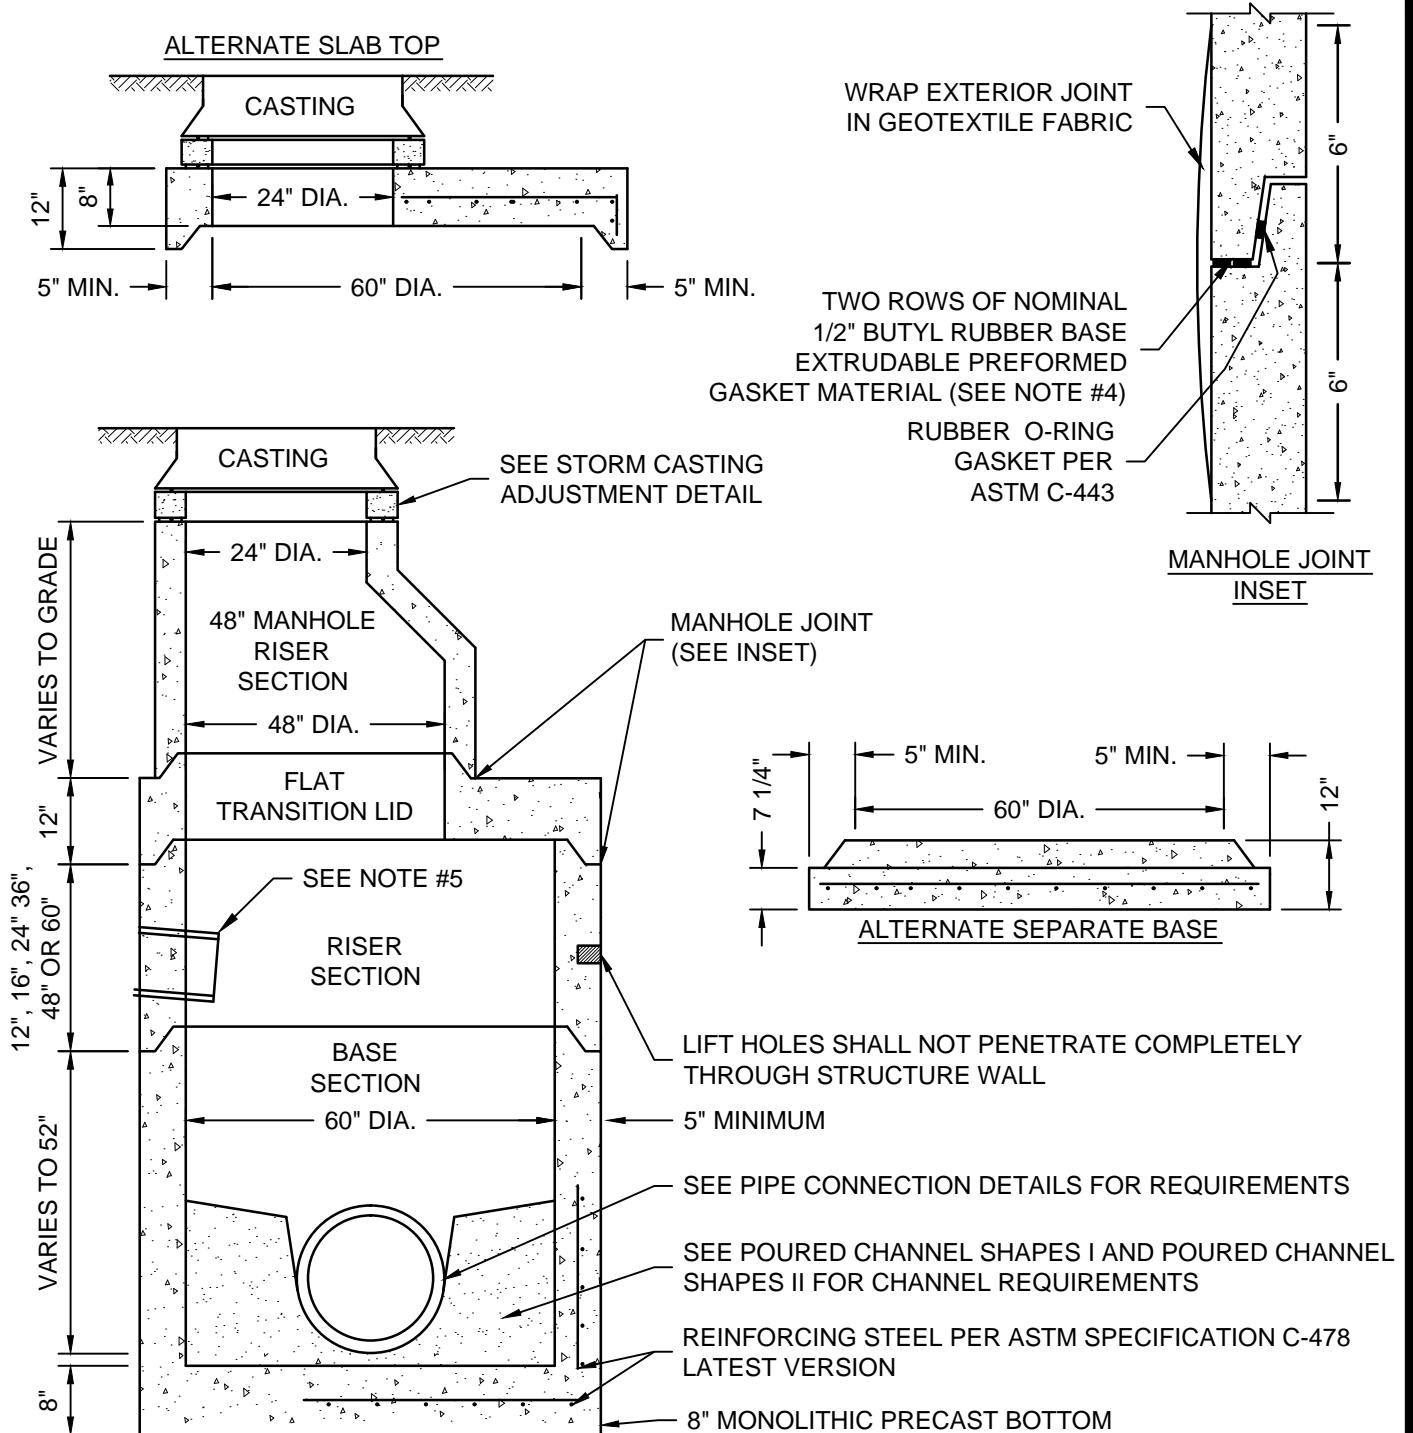

NOTES:

- FOR ALTERNATE CAST-IN-PLACE BASE, SEE CAST IN PLACE BASE 48" AND LESS DETAIL.
- THE BASE SHALL BE PLACED ON COMPACTED CRUSHED STONE, 4" MINIMUM.
- THE INSIDE WALL DISTANCE BETWEEN OPENINGS SHALL BE A MINIMUM OF 6".
- USE RU 106 RUB'RNEK LTM AS MANUFACTURED BY HENRY CO., KENT-SEAL NO. 2 AS MANUFACTURED BY HAMILTON-KENT OR EZ-STICK BUTYL-RUBBER-BASED PREFORMED FLEXIBLE SEALANT AS MANUFACTURED BY PRESS-SEAL.
- UNDERDRAIN CONNECTIONS SHALL BE ABOVE BENCH. SEE PIPE CONNECTION DETAILS FOR REQUIREMENTS.