




# 72" STORM MANHOLE

Created: January 1, 2002

Revised: September 4, 2015

Scale: N.T.S.

Approved: May 16, 2012

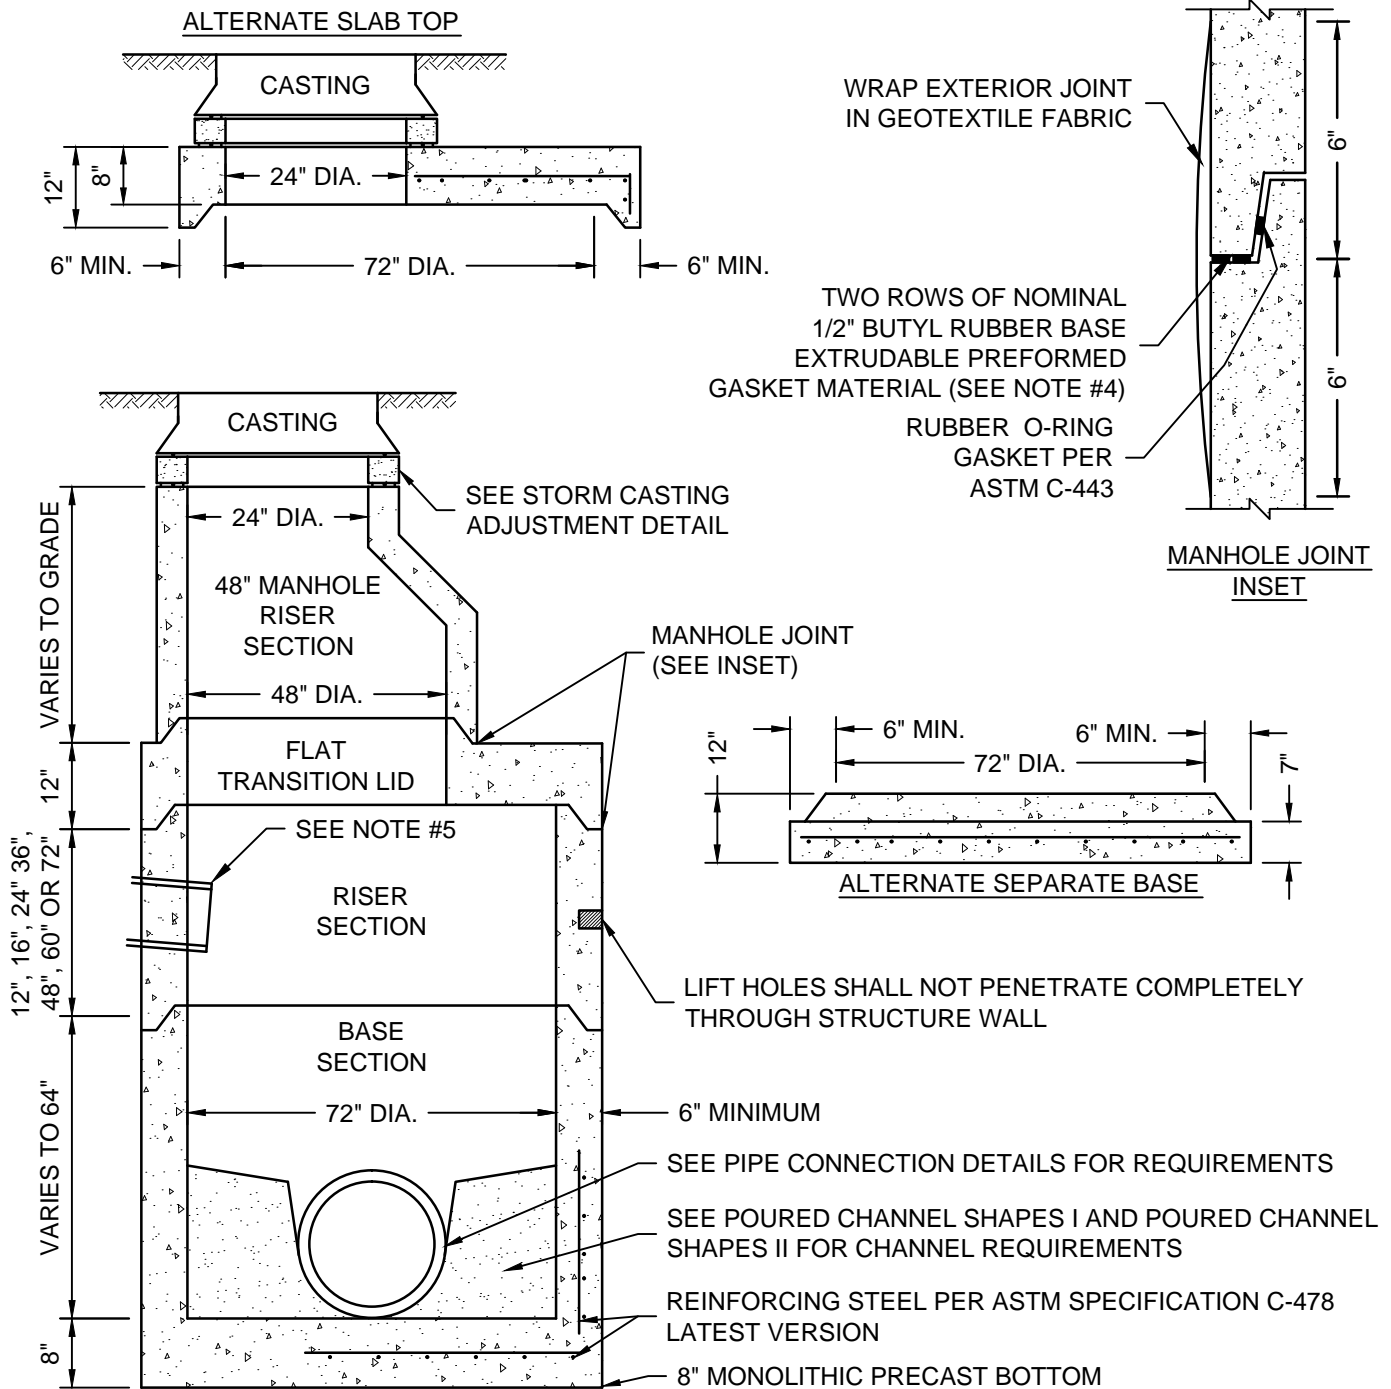

**NOTES:**

1. FOR ALTERNATE CAST-IN-PLACE BASE, SEE CAST IN PLACE BASE 48" AND LESS DETAIL.
2. THE BASE SHALL BE PLACED ON COMPACTED CRUSHED STONE, 4" MINIMUM.
3. THE INSIDE WALL DISTANCE BETWEEN OPENINGS SHALL BE A MINIMUM OF 6".
4. USE RU 106 RUB'RNK LTM AS MANUFACTURED BY HENRY CO., KENT-SEAL NO. 2 AS MANUFACTURED BY HAMILTON-KENT OR EZ-STICK BUTYL-RUBBER-BASED PREFORMED FLEXIBLE SEALANT AS MANUFACTURED BY PRESS-SEAL.
5. UNDERDRAIN CONNECTIONS SHALL BE ABOVE BENCH. SEE PIPE CONNECTION DETAILS FOR REQUIREMENTS.