




FIELD-CREATED 30" ROUND INLET

Created: July 21, 2010

Revised: October 30, 2015

Scale: N.T.S.

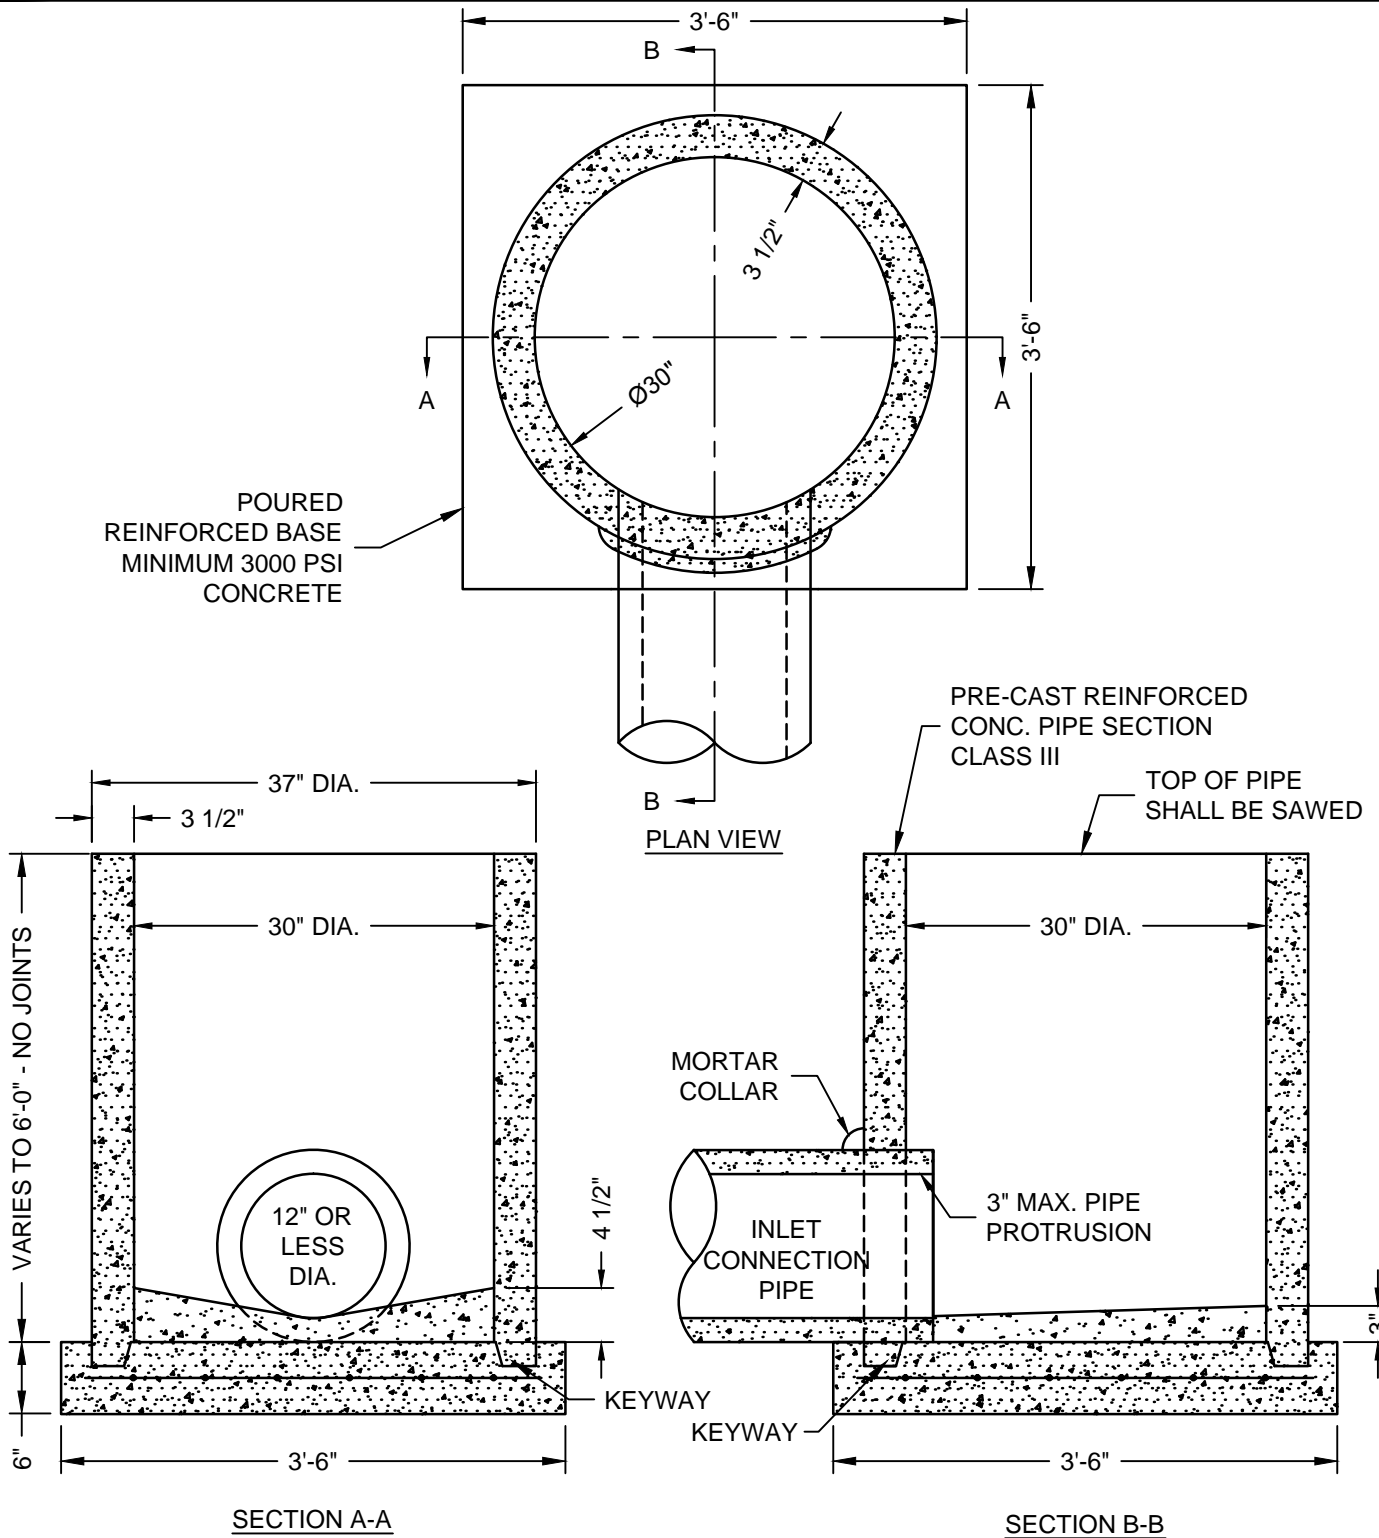

NOTES:

1. THE CASTING TO BE USED WITH THIS INLET SHALL BE A 2'X2' CURB AND GUTTER OR A 2'X2' ALLEY OR OTHER PRE-APPROVED CASTING AS NOTED ON THE PROJECT DETAIL SHEET(S).
2. ALL PRE-CAST CONCRETE TO BE A MINIMUM OF 4500 PSI @ 28 DAYS
3. REINFORCING IN CONCRETE BASE SHALL BE 6X6 - 10/10 STEEL MESH
4. APPROVAL FROM CITY'S PROJECT CONTACT AND/OR PROJECT ENGINEER MUST BE ACQUIRED BEFORE USING THIS STRUCTURE