




SERVICE INSTALLATIONS


Created: January 1, 2002

Revised: November 8, 2016


Scale: N.T.S.

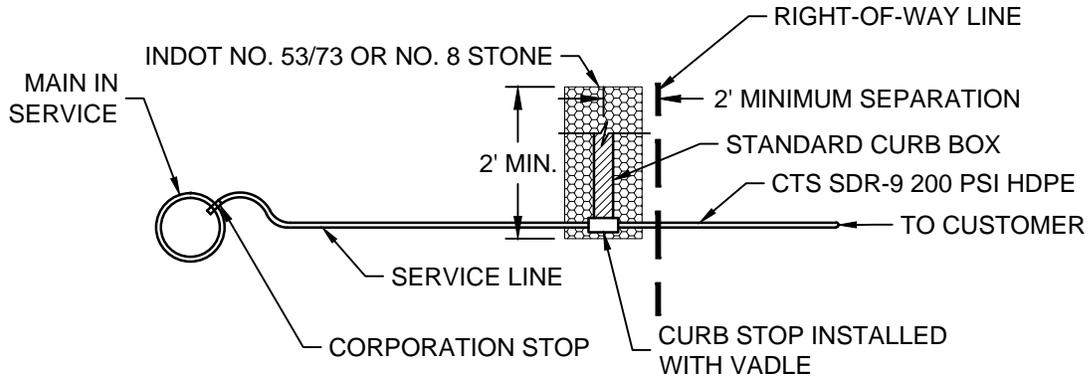

SMALL SERVICE INSTALLATION
3/4" THRU 2" (MIN. 5' COVER)

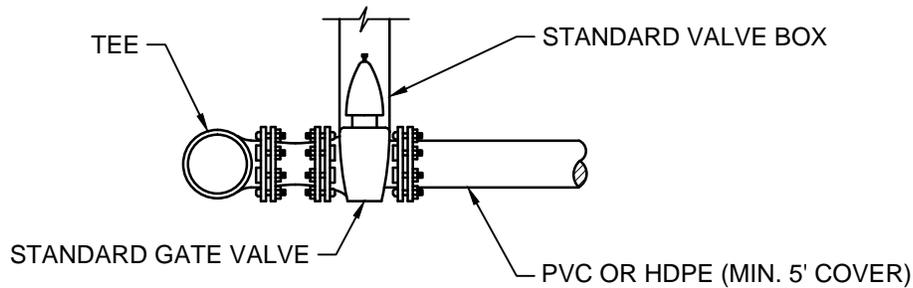

LARGE SERVICE INSTALLATION WITH NEW WATER MAIN INSTALLATION
4" & LARGER

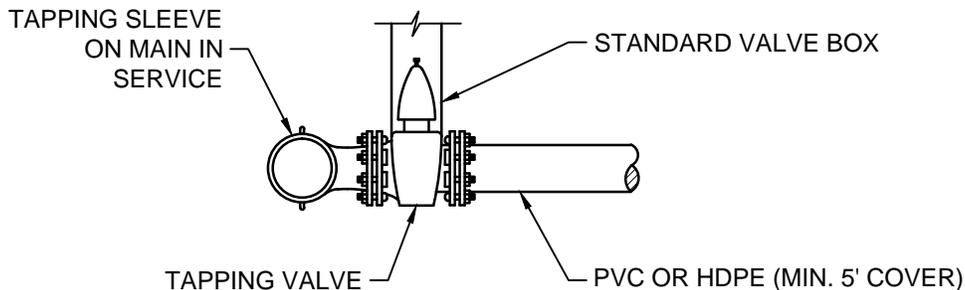

LARGE SERVICE INSTALLATION ON EXISTING WATER MAIN IN SERVICE
4" & LARGER

NOTES:

1. DO NOT PLACE CURB BOX WITHIN PAVED AREAS (SIDEWALKS, DRIVEWAYS, STREETS).
2. HDPE MAIN SERVICE TAPS SHALL USE ELECTRO FUSION SADDLES FOR NEW AND EXISTING MAINS OF ALL SIZES.