City Utilities
Design Standards
Manual

60" STORM MANHOLE

Created: January 1, 2002 Revised: January 19, 2017

Scale: N.T.S.

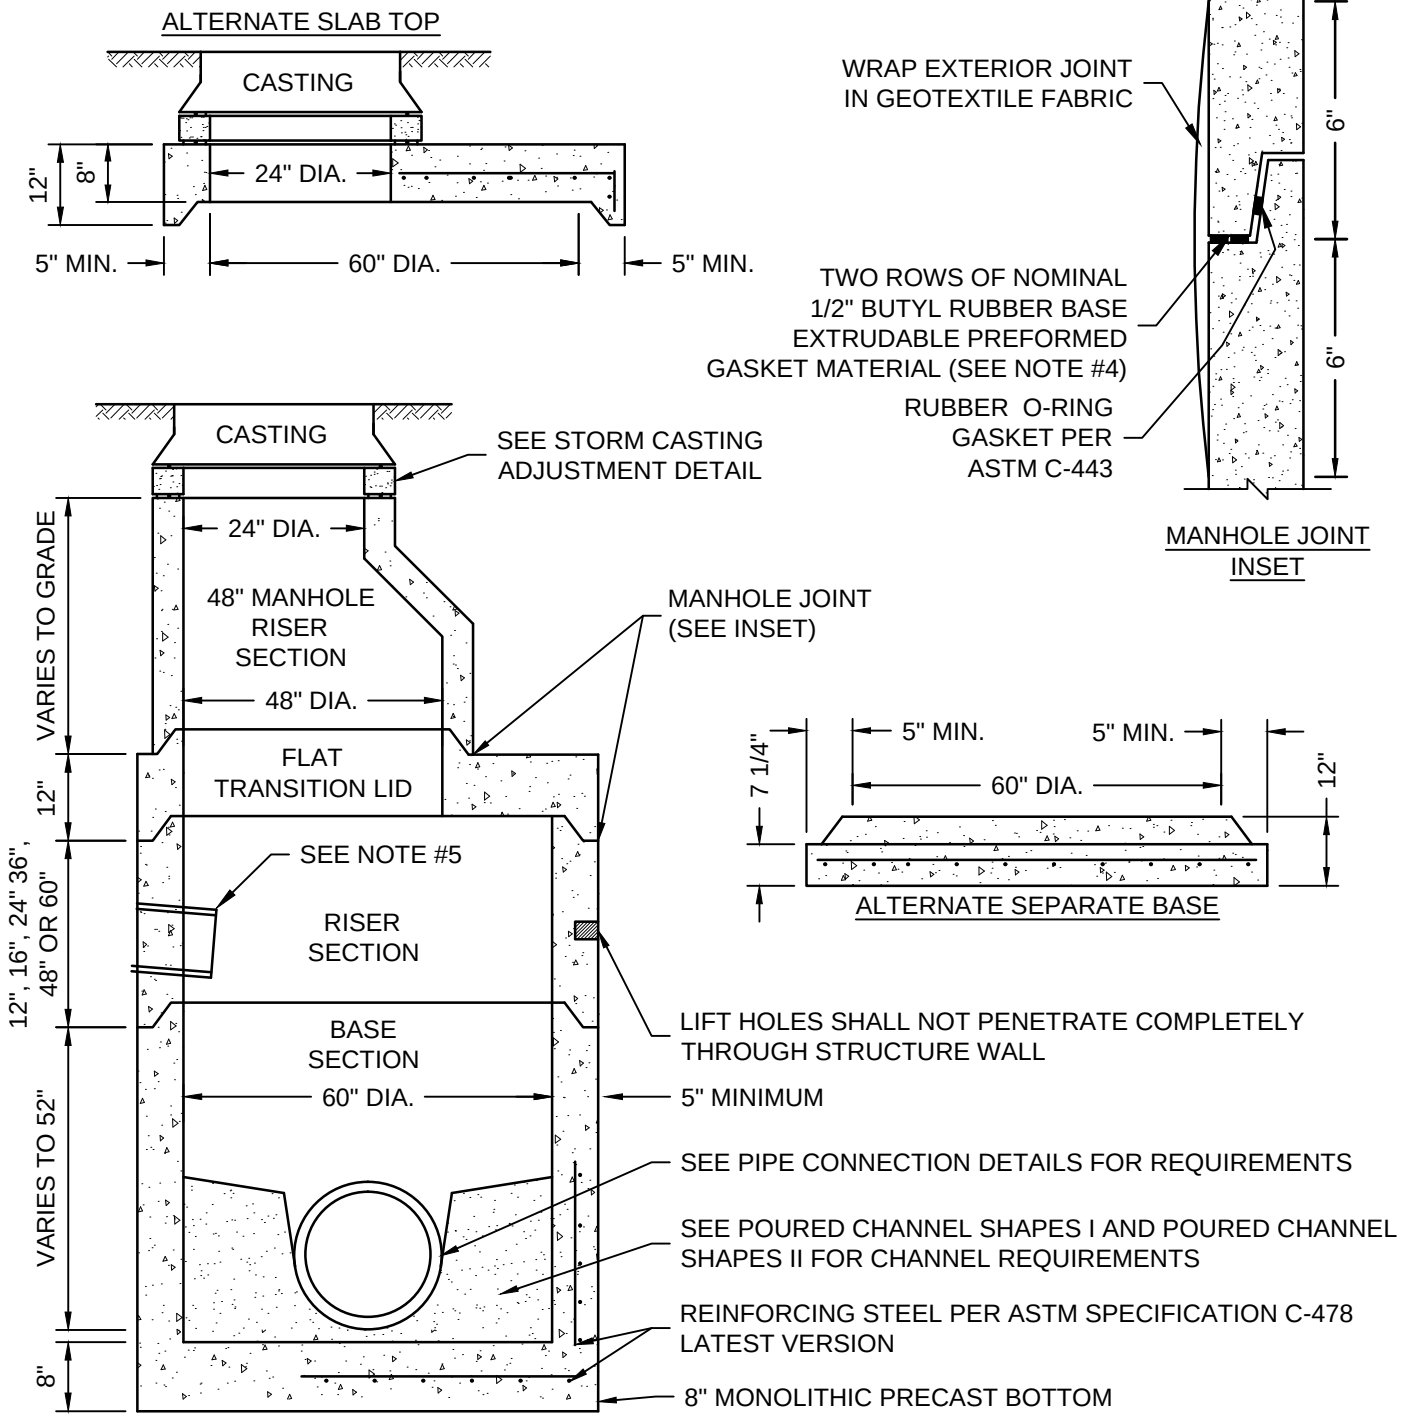

NOTES:

1. FOR ALTERNATE CAST-IN-PLACE BASE, SEE CAST IN PLACE BASE 48" AND LESS DETAIL.
2. THE BASE SHALL BE PLACED ON COMPACTED CRUSHED STONE, 4" MINIMUM.
3. THE INSIDE WALL DISTANCE BETWEEN OPENINGS SHALL BE A MINIMUM OF 6".
4. USE RU 106 RUB'RNEK LTM AS MANUFACTURED BY HENRY CO., KENT-SEAL NO. 2 AS MANUFACTURED BY HAMILTON-KENT OR EZ-STICK BUTYL-RUBBER-BASED PREFORMED FLEXIBLE SEALANT AS MANUFACTURED BY PRESS-SEAL.
5. UNDERDRAIN CONNECTIONS SHALL BE ABOVE BENCH. SEE PIPE CONNECTION DETAILS FOR REQUIREMENTS.