




TEMPORARY/PERMANENT BLOW-OFF INSTALLATION


Created: January 1, 2002

Revised: April 12, 2019

Scale: N.T.S.

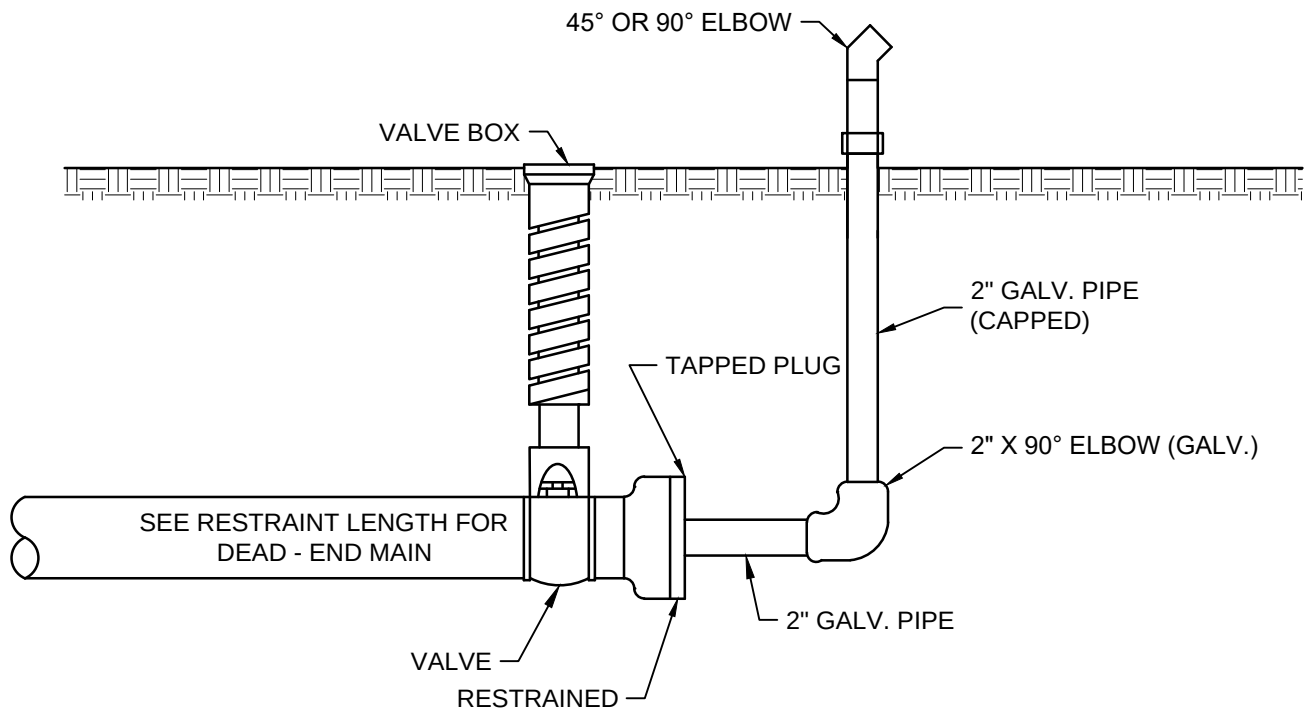

TEMPORARY BLOW-OFF ASSEMBLY INSTALLATION

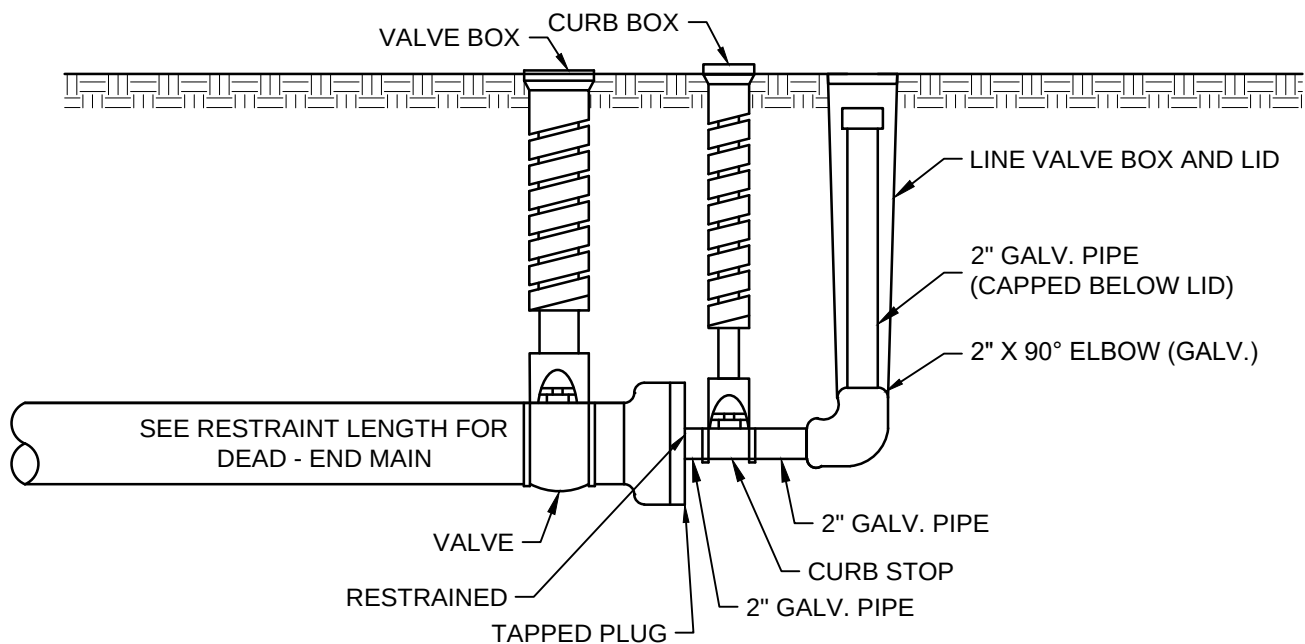

PERMANENT BLOW-OFF ASSEMBLY INSTALLATION

NOTES:

1. ALL MATERIALS FURNISHED BY CONTRACTOR AND INSTALLED BY CONTRACTOR, UNLESS OTHERWISE SPECIFIED.
2. TRACING WIRE REQUIRED FOR ALL PIPE .
3. ALL PERMANENTLY INSTALLED MAINLINE VALVES SHALL INCLUDE A VALVE BOX AND LID PER VALVE BOX DETAIL
4. VALVES EQUAL TO OR LESS THAN 16 INCHES SHALL BE GATE VALVES.