




# FIRE HYDRANT ASSEMBLY TYPE III

Created: January 1, 2002

Revised: February 23, 2023

Scale: N.T.S.

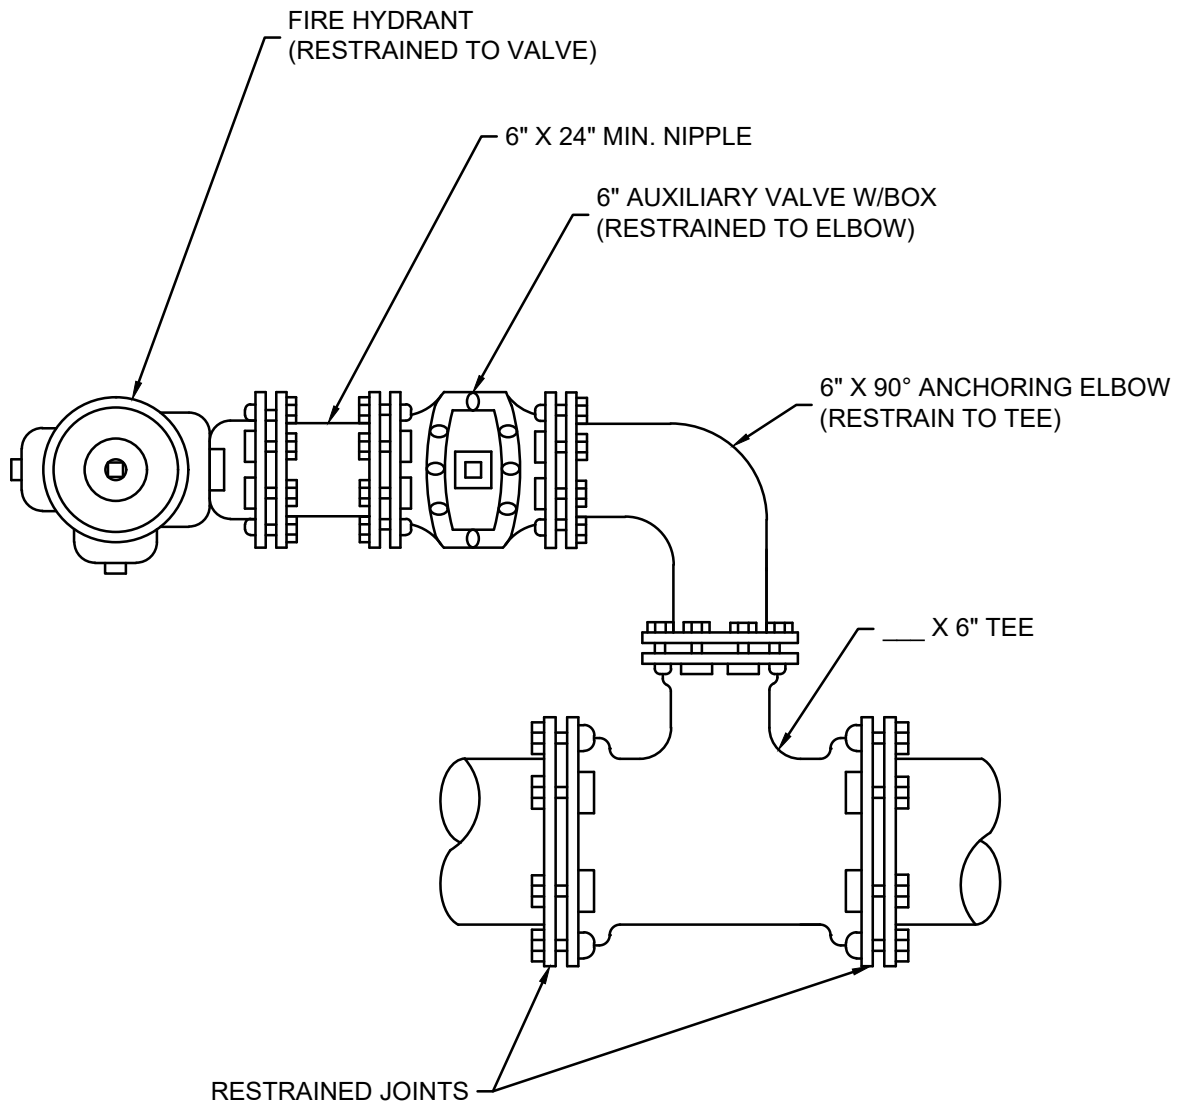

FIRE HYDRANT ASSEMBLY TYPE III

NOTES:

1. THIS ARRANGEMENT CAN BE USED ON ALL SIZES OF MAINS.
2. FIRE HYDRANTS SHALL BE INSTALLED PER "STANDARD FIRE HYDRANT SETTING" DETAIL.
3. ALL PIPING FROM TEE TO HYDRANT SHALL BE RESTRAINED.