




LOW PRESSURE BUILDING SEWER - SERVICE CONNECTION DETAIL

Created: January 1, 2002

Revised: July 12, 2023

Scale: N.T.S.

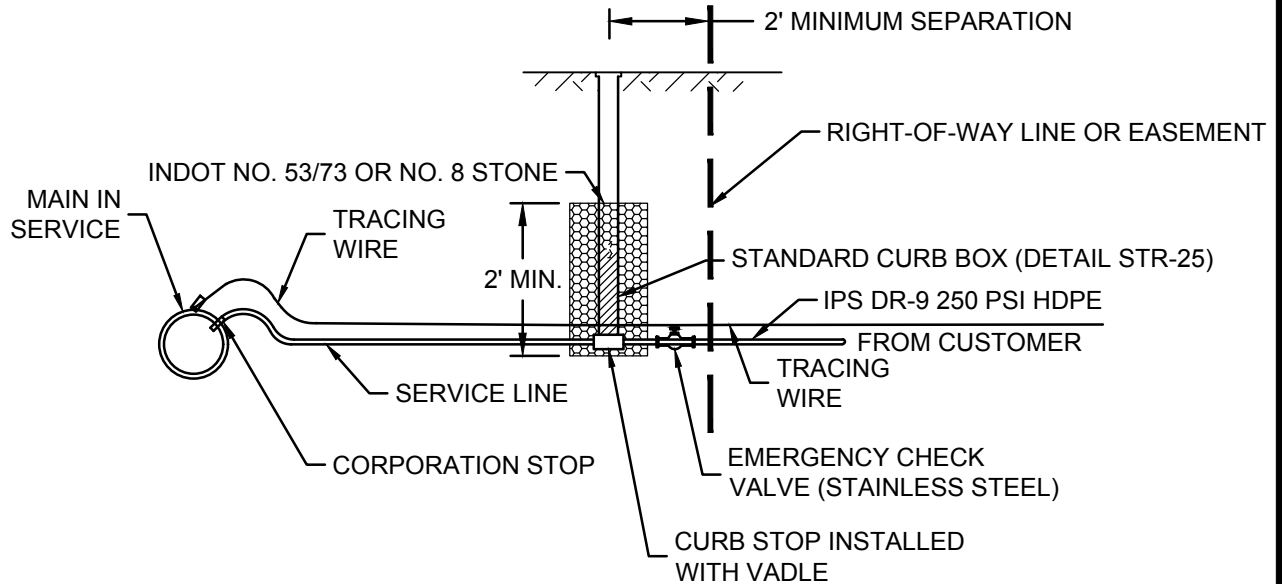

SMALL SERVICE INSTALLATION
1.5" THRU 2" (MIN. 5' COVER)

NOTES:

1. DO NOT PLACE CURB BOX WITHIN PAVED AREAS (SIDEWALKS, DRIVEWAYS, STREETS).
2. HDPE MAIN SERVICE TAPS SHALL USE ELECTRO FUSION SADDLES FOR NEW AND EXISTING MAINS OF ALL SIZES.
3. NON-HDPE MAIN SERVICE TAPS SHALL USE MECHANICAL TAPPING SLEEVES FOR NEW AND EXISTING MAINS OF ALL SIZES.